


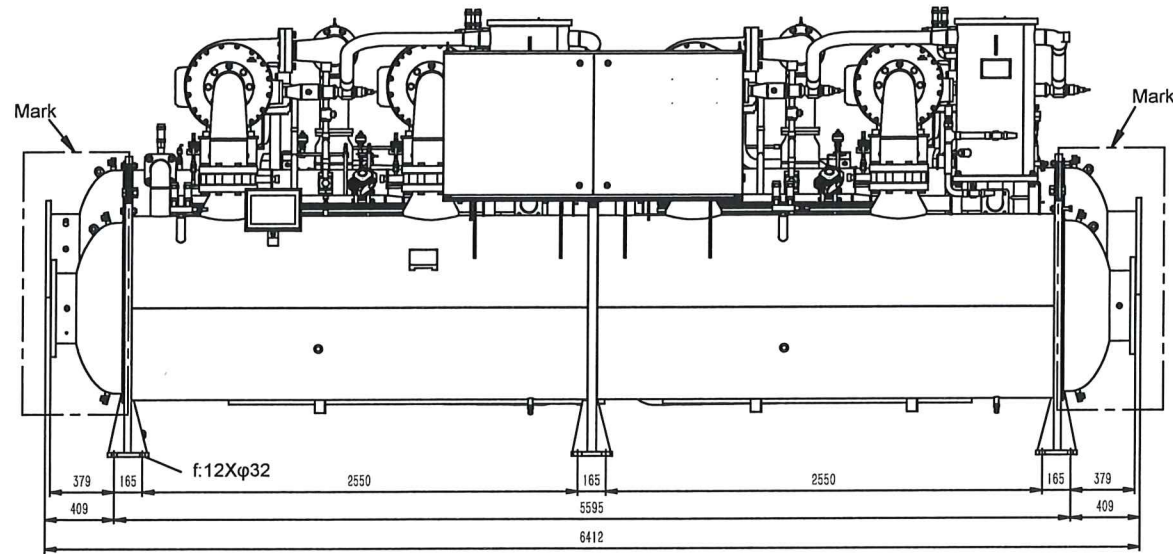


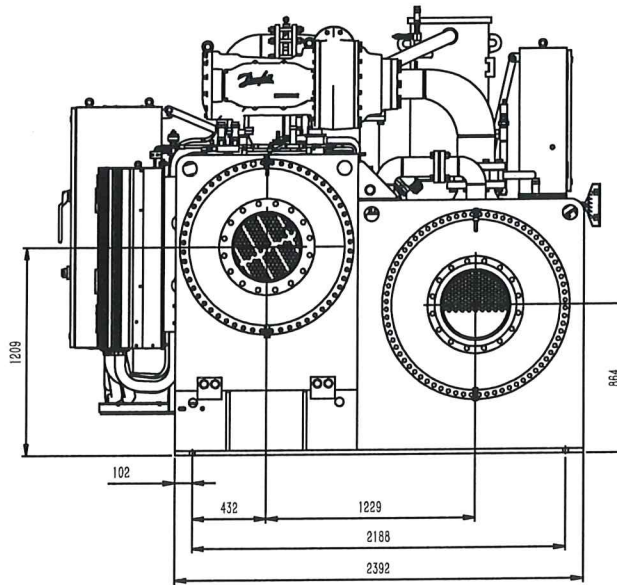


View A

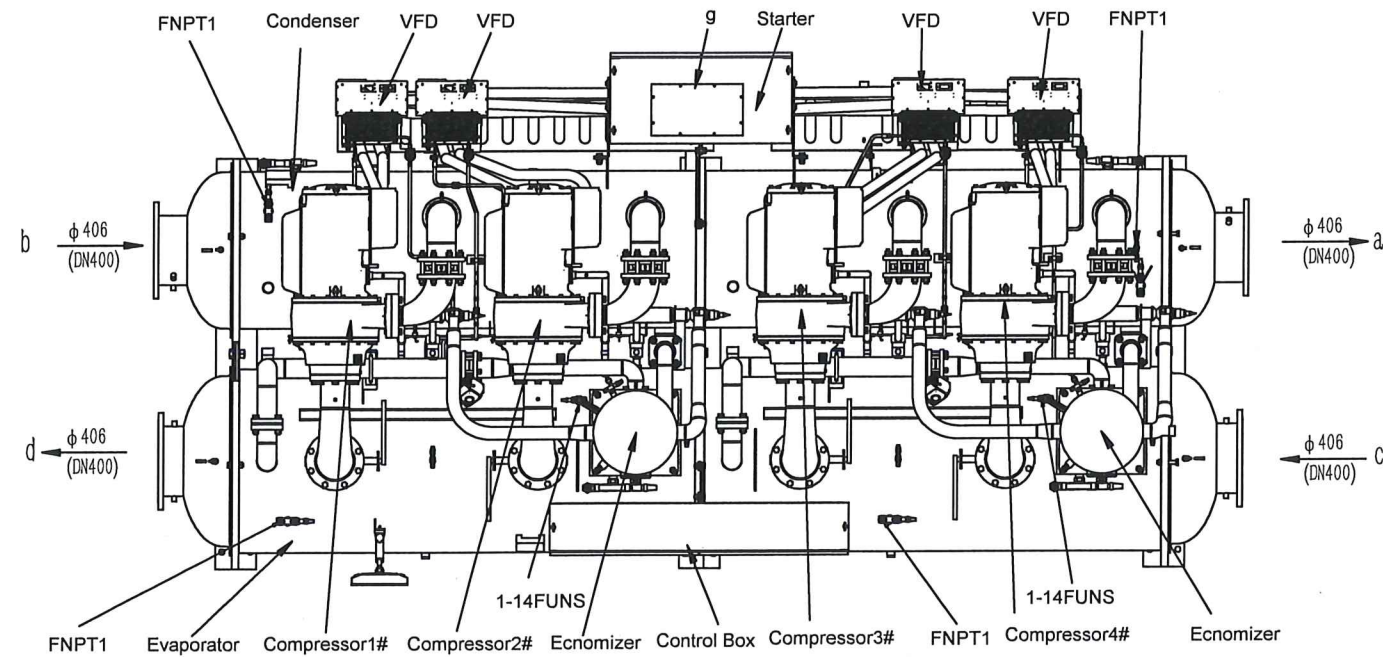

View A

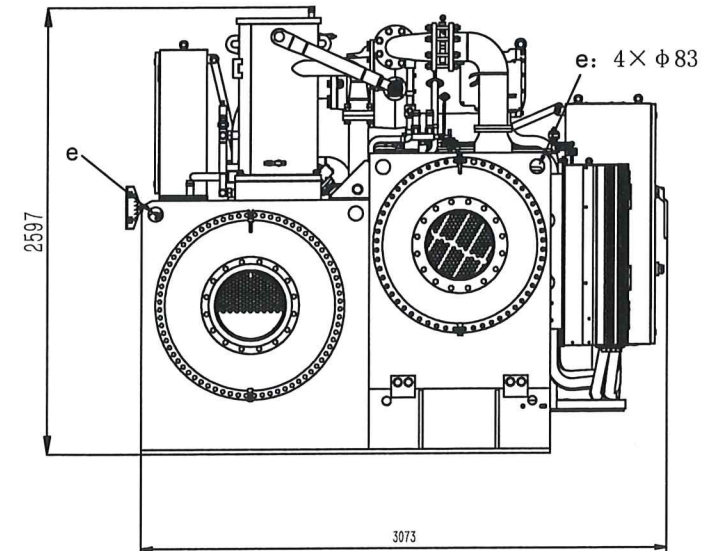

Mark





Notes:

1. a: Condenser outlet; b: Condenser inlet; c: Evaporator inlet; d: Evaporator outlet; e: Lifting lug; f: Anchor hole size; g: Starting cabinet inlet
2. The tolerance of layout dimension is $\pm 13\text{mm}$.
3. Nozzle fitting type is optional, there is no effect on the chiller dimension no matter victaulic groove or flange you choose.
4. The dimensions and weights are for reference only, subject to the actual situation.

Drawing:	HXE160Q- GA Drawing		
Project Name:			
Consultant:		Version:	
Model:	VTX4-F3918/C3618		
Drawn by:	张圣万	Date: 2024.12.23	Scale: 1:1
Checked by:	曹宏佳	Date: 2024.12.23	Dwg No.:
Approved by:	孙金少	Date: 2024.12.23	Page:



No. 33 Checheng road, Wuhan economical and technological development zone, Wuhan, Hu bei, China
Post code: 430056
Fax: +86-27-59408788


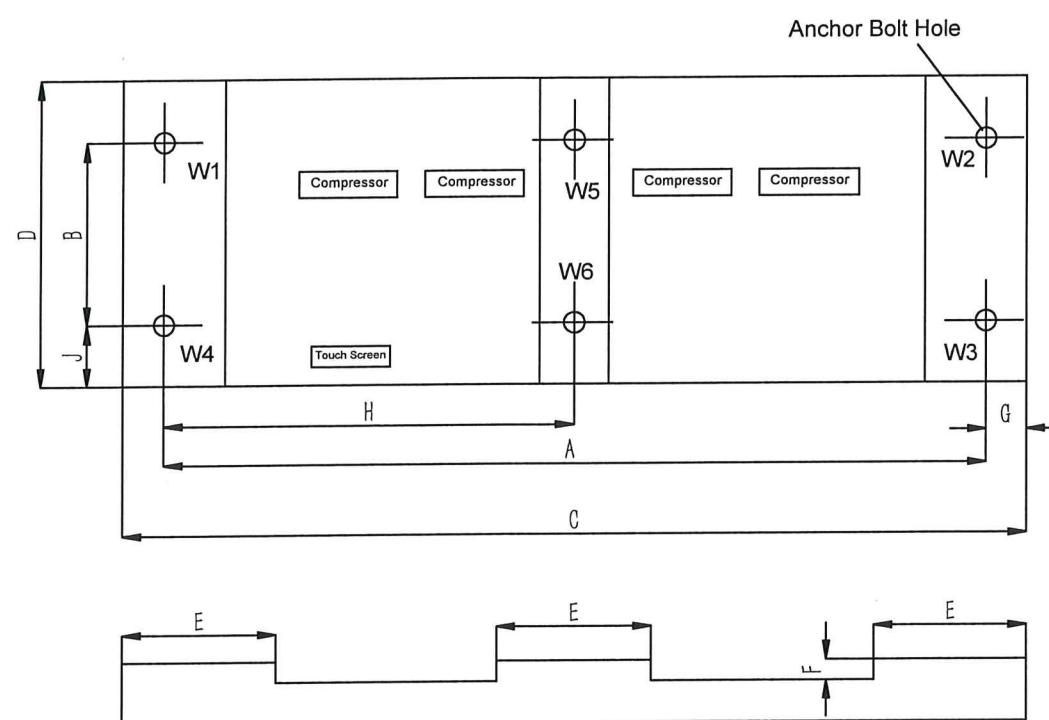
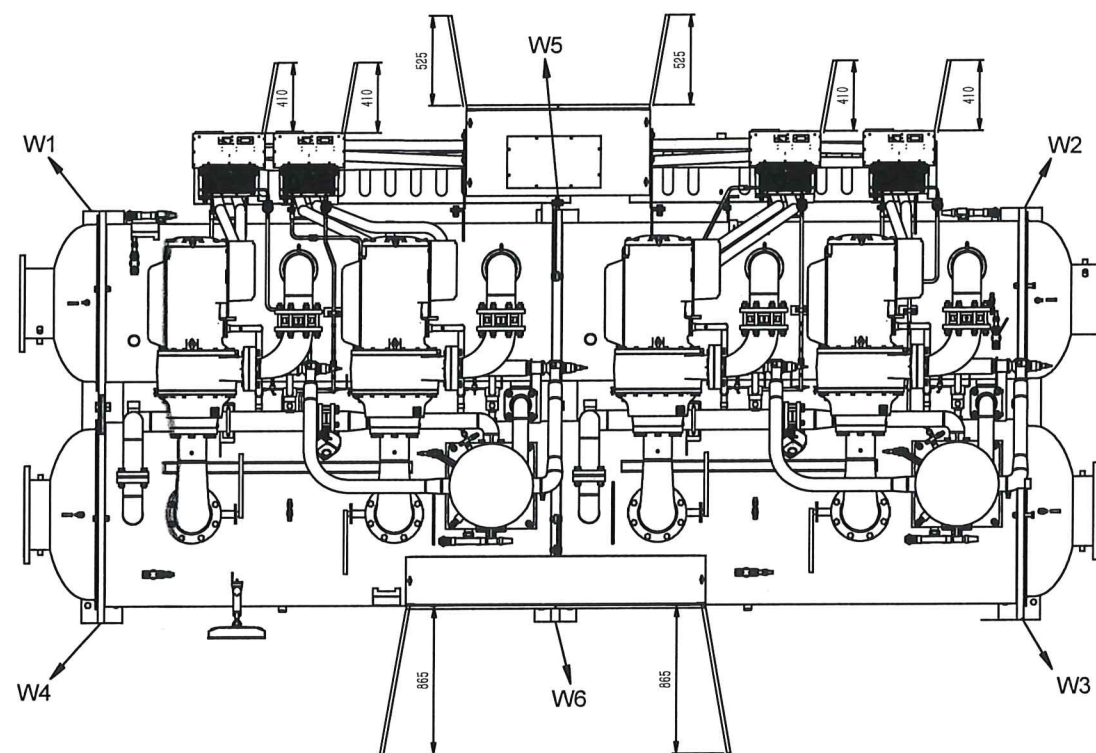


Weight Distribution (Quadra Comp.)			Unit: kg					
Model	Shipping Weight	Operating Weight	W1	W2	W3	W4	W5	W6
HXE160Q-F3918/C3618	15800	18086	2891	3717	3140	2314	3301	2723

Foundation Size Requirement:							Unit: mm		
Model	A	B	C	D	E	F	G	J	H
HXE160Q-F3918/C3618	5595	2188	6095	2688	750	100	250	250	2715

Note:
 1. Above drawing indicates chiller Point Load and Panel opening angle.
 2. The above load weight is the maximum weight of vessel configuration,
 The specific value is subject to the weight on the unit nameplate.

Drawing:	HXE160Q - Foundation Drawing			 No. 33 Checheng road, Wuhan economical and technological development zone, Wuhan, Hu bei, China Post code: 430056 Fax: +86-27-59408788
Project Name:				
Consultant:		Version:		
Model:	VTX4-F3918/C3618			
Drawn by:	张彦乃	Date: 2024.12.23	Scale:	
Checked by:	潘宏建	Date: 2024.12.23	Dwg No.:	
Approved by:	孙金少	Date: 2024.12.23	Page:	2 of 4

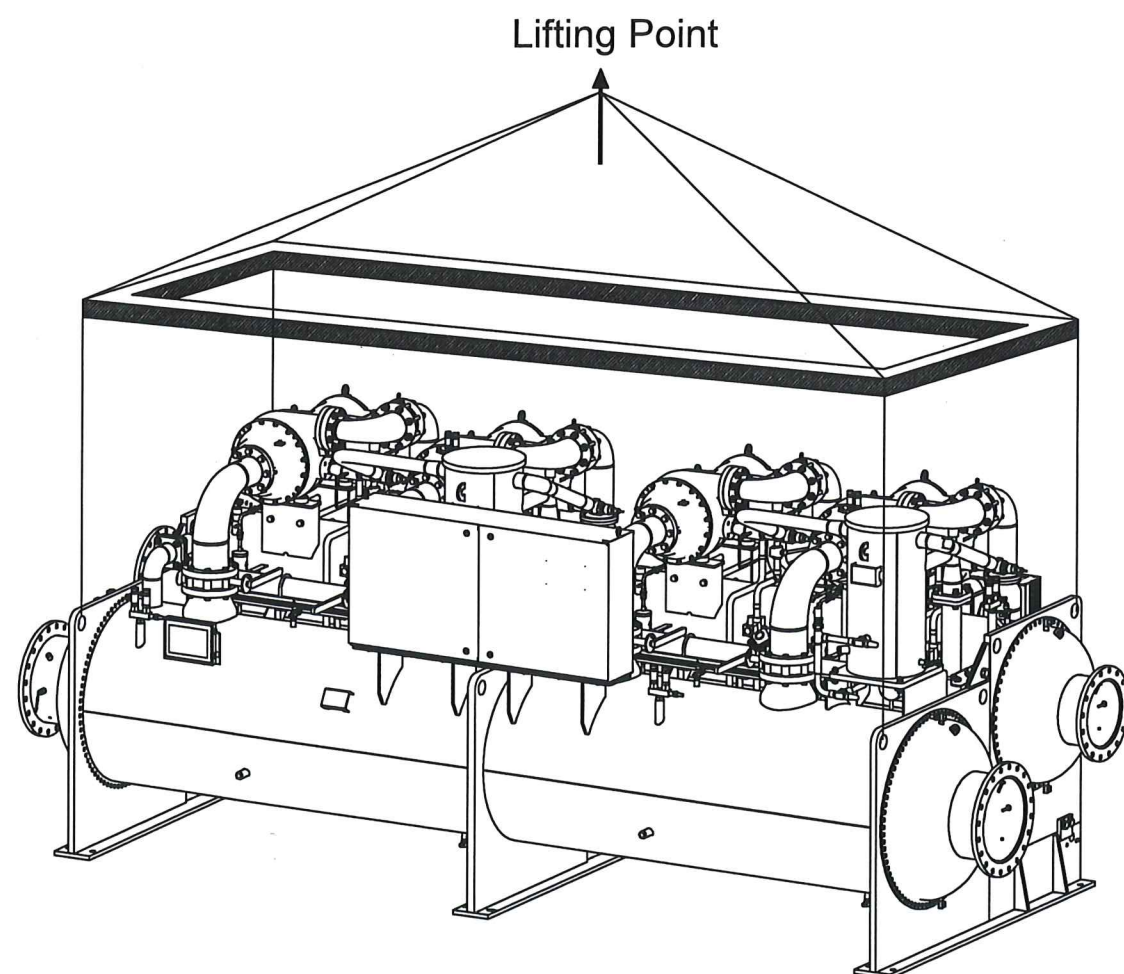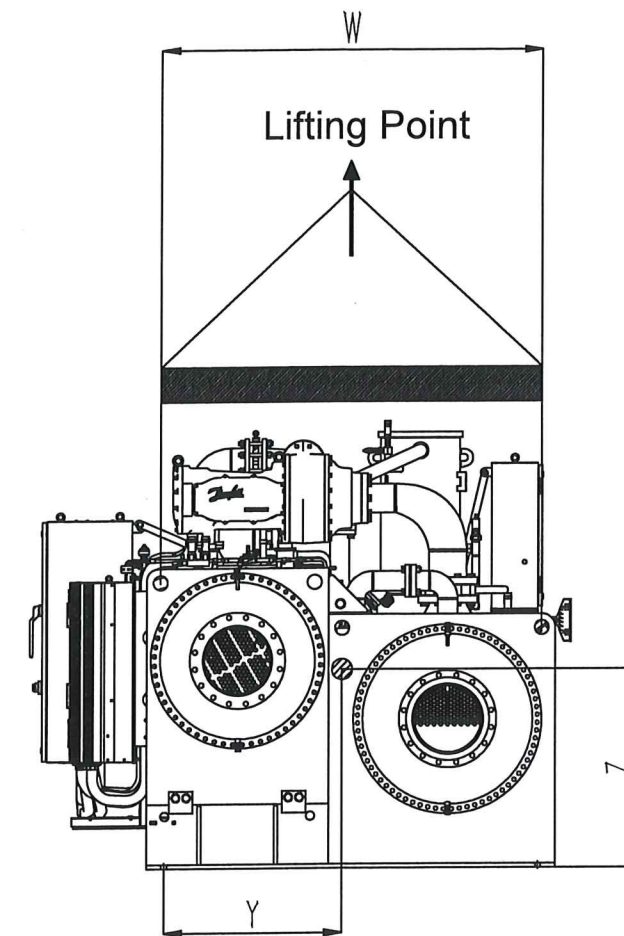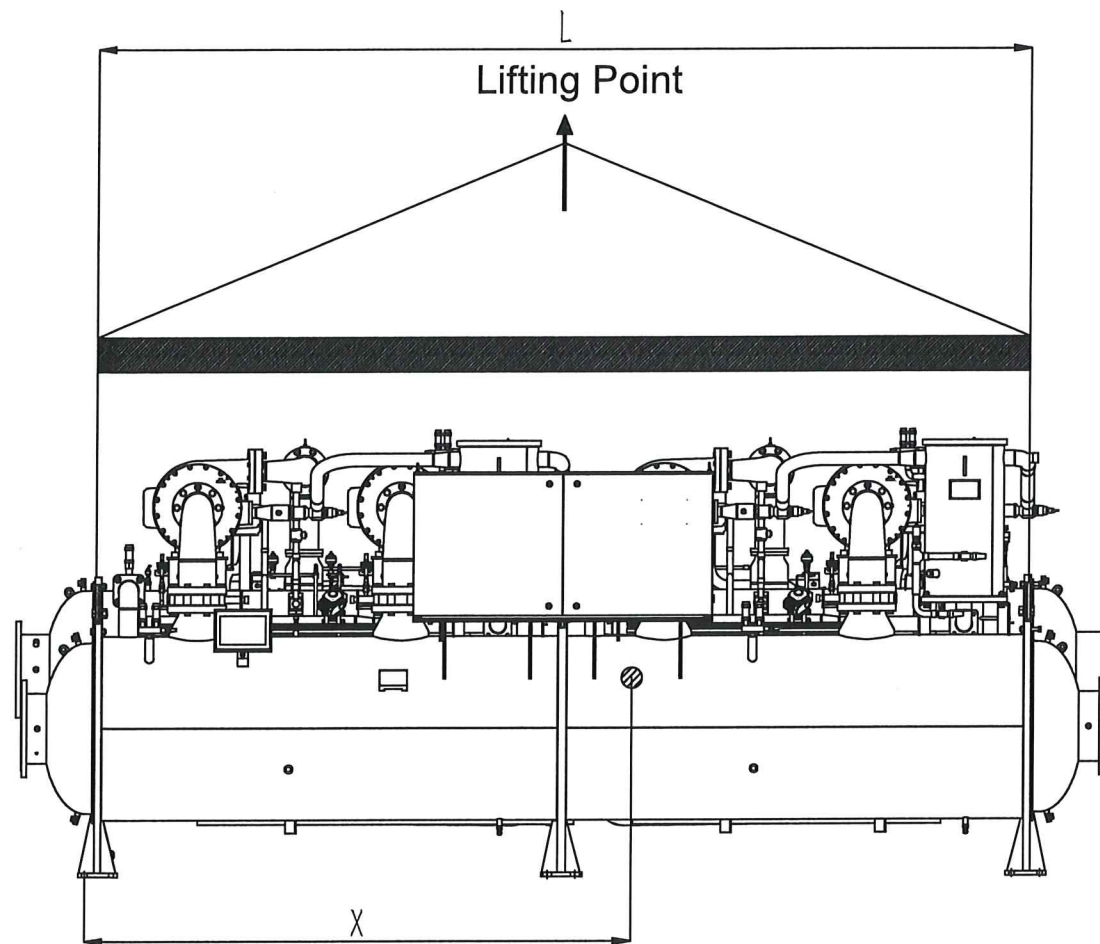


Model (Quadra Comp.)	Weight(kg)	X(mm)	Y(mm)	Z(mm)	Min L(mm)	Min W(mm)
HXE160Q-F3918/C3618	15800	2982	1082	1164	5500	2300

Drawing:	HXE160Q - Hoisting Drawing				
Project Name:					
Consultant:				Version:	
Model:	VTX4-F3918/C3618				
Drawn by:	张彦万	Date:	2024.12.23	Scale:	
Checked by:	潘宏建	Date:	2024.12.23	Dwg No.:	
Approved by:	孙金少	Date:	2024.12.23	Page:	3 of 4



No. 33 Checheng road, Wuhan economical and technological development zone, Wuhan, Hu bei, China
Post code: 430056
Fax: +86-27-59408788

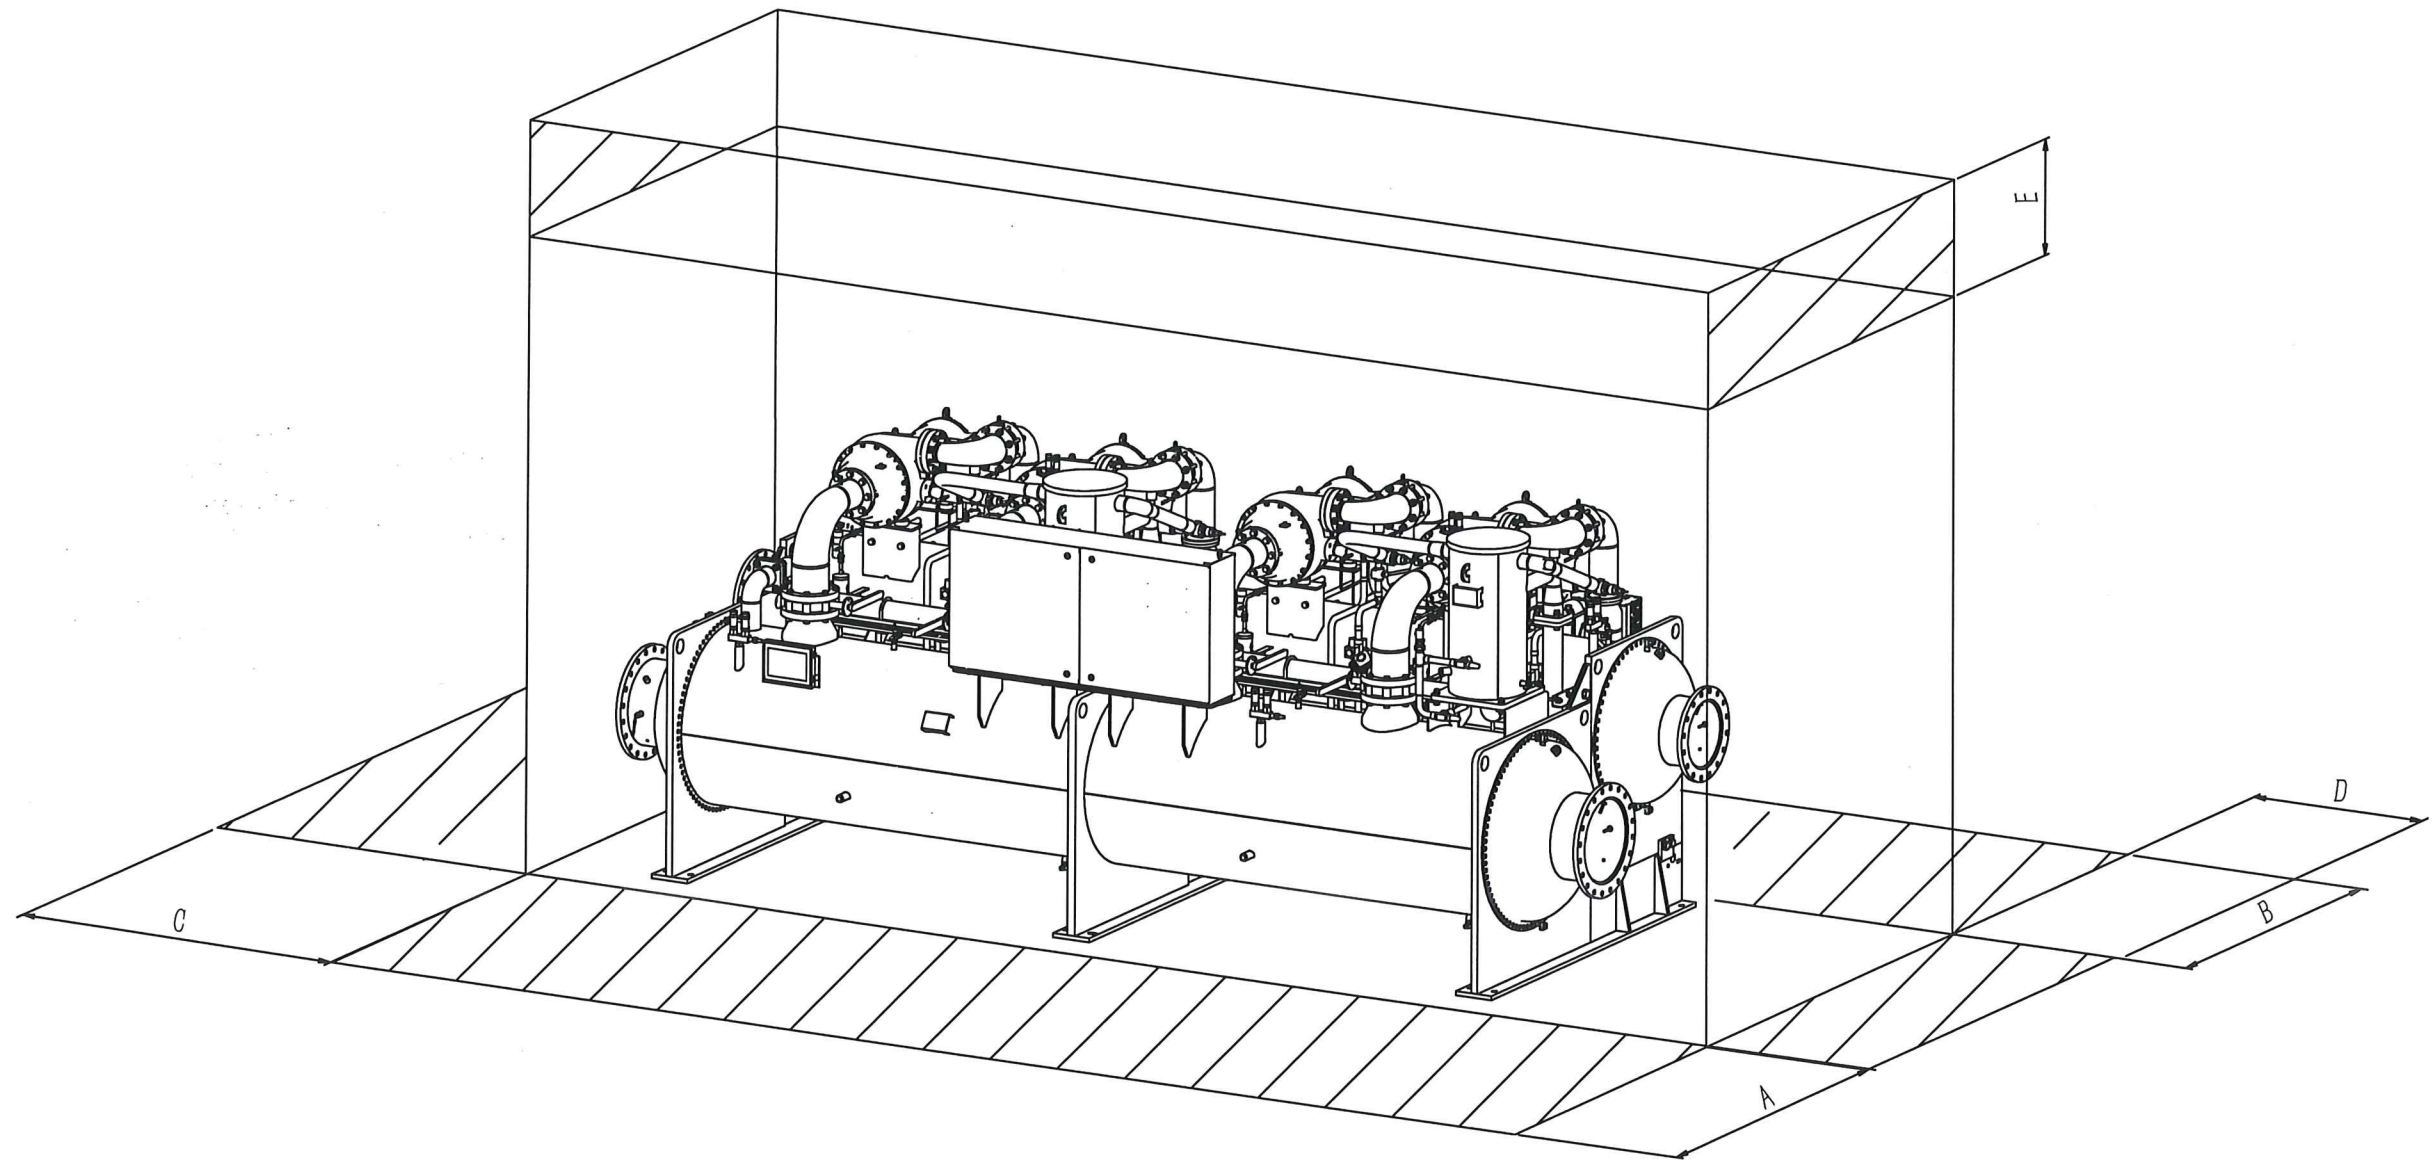

Notes:

1. Check the length of the evaporator on the nameplate (eg:F3918,means the length of the evaporator is 18 ft) .
2. The unit must be located to provide sufficient service space to facilitate test, commissioning and maintenance of the chiller.
3. Service space must be clean and unblocked to ensure maintenance convenience.
4. This dimension specification is not applicable to special designed chiller.
- 5.The dimensions and weights are for reference only, subject to the actual situation.
- 6.The dimensions of maintenance space on both sides of C and D are interchangeable

Length of evaporator	A	B	C	D	E
	Front	Rear	Left	Right	Top
18ft	≥1000mm	≥1000mm	≥6000mm	≥3000mm	≥1000mm

Drawing:	HXE160Q - Service Space Drawing			 No. 33 Checheng road, Wuhan economical and technologycal development zone,Wuhan,Hu bei, China Post code: 430056 Fax: +86-27-59408788	
Project Name:					
Consultant:		Version:			
Model:	VTX4-F3918/C3618				
Drawn by:	張佳宁	Date: 2024.12.23	Scale:		
Checked by :	潘家健	Date: 2024. 12. 23	Dwg No.:		
Approved by:	孙国少	Date: 2024.12.23	Page:	4 of 4	